

# Aggregate Optimization Chart

# Production Gradation Report

PLANT #: **P-32**

Sample Date: **8/2/21**

Dates Test Represents: **8/3/2021**

through **8/9/2021**

Concrete Grade: **S2M**

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	Contribution %
6AA	71-47	Presque Isle	1600	9.79	2.62	52.5
26A	71-47	Presque Isle	220	1.35	2.62	7.2
NNS	95-013	Smelter Bay	1230	7.44	2.65	40.3
Total Wt			3050	18.57		100.0


Verify this number is 100%

Sieve	6AA	26A	NNS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	96.5	100.0	100.0	98.2	1.8	1.8
3/4"	82.0	100.0	100.0	90.6	7.6	9.4
1/2"	46.5	96.4	100.0	71.7	18.9	28.3
3/8"	26.7	88.5	100.0	60.7	11.0	39.3
#4	5.8	19.2	96.5	43.3	17.4	56.7
#8	2.5	4.6	83.2	35.2	8.1	64.8
#16	2.1	2.1	66.8	28.2	7.0	71.8
#30	2.0	1.6	47.8	20.4	7.8	79.6
#50	1.9	1.5	22.7	10.3	10.2	89.7
#100	1.8	1.4	5.7	3.3	6.9	96.7
LBW	1.4	1.1	1.0	1.2	2.1	98.8

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max.  
 nom. max. #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max.  
 nom. max. #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when  
 a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations


Coarseness Factor: **61** Workability Factor: **35**

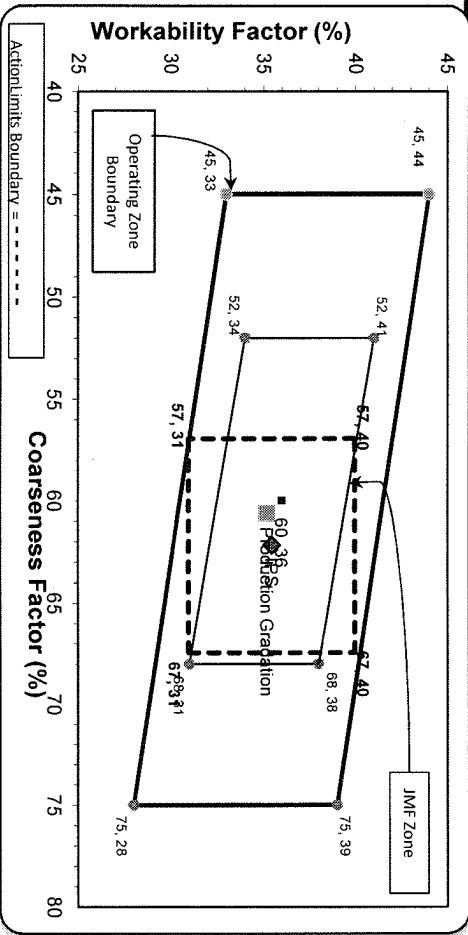

Initial Production Sample (IPS)

Coarseness Factor: **62** Workability Factor: **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	94.0	6.0	6.0
1/2"	70.2	23.7	29.8
3/8"	59.9	10.4	40.1
#4	42.7	17.2	57.3
#8	35.5	7.2	64.5
#16	28.4	7.0	71.6
#30	19.2	9.2	80.8
#50	8.9	10.3	91.1
#100	3.1	5.9	96.9
LBW	1.4	1.7	98.6



Superior Materials, LLC  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

PREPARED BY:  
 SM, LLC Technical Service

Approved By: \_\_\_\_\_

Plant 958-JMT

Product 1022-2NS GR - Smelter Bay

Name/Title Doug Storey / QC Technician

Period: 08/01/2021 - 08/07/2021

Report Date 08/06/2021

Procedure	Sieve/Test	Result	Unit	2NS GR Spec
	3/8" (9.5mm)	100.0	%	100-100
	#4 (4.75mm)	96.5	%	95-100
	#8 (2.36mm)	83.2	%	65-95
	#16 (1.18mm)	66.8	%	35-75
	#30 (.6mm)	47.8	%	20-55
	#50 (.3mm)	22.7	%	10-30
	#100 (.15mm)	5.7	%	0-10
	#200 (75µm)	1.3	%	
	FM	2.77		2.6-3
	Wash Loss (#200/75um)	1.0	%	0-3
	Total Moisture	4.5	%	

Plant 958-JMT

Product 1067-26A Mod LS

Name/Title Doug Storey / QC Technician

Period: 08/01/2021 - 08/07/2021

Report Date 08/06/2021

Procedure	Sieve/Test	Result	Unit	26A Mod LS Spec
	2" (50mm)	100.0	%	
	1 1/2" (37.5mm)	100.0	%	
	1" (25mm)	100.0	%	
	3/4" (19mm)	100.0	%	100-100
	1/2" (12.5mm)	96.4	%	95-100
	3/8" (9.5mm)	88.5	%	60-95
	#4 (4.75mm)	19.2	%	5-30
	#8 (2.36mm)	4.6	%	0-12
	#16 (1.18mm)	2.1	%	
	#30 (.6mm)	1.6	%	
	#50 (.3mm)	1.5	%	
	#100 (.15mm)	1.4	%	
	#200 (75µm)	1.2	%	
	Wash Loss (#200/75um)	1.1	%	0-3
	Total Moisture	3.0	%	

Plant 958-JMT

Product 1054-6AA LS PI

Name/Title Doug Storey / QC Technician

Period: 08/01/2021 - 08/07/2021

Report Date 08/06/2021

Procedure	Sieve/Test	Result	Unit	6AA LS PI Spec
	2" (50mm)	100.0	%	
	1 1/2" (37.5mm)	100.0	%	100-100
	1" (25mm)	96.5	%	95-100
	3/4" (19mm)	82.0	%	
	1/2" (12.5mm)	46.5	%	30-60
	3/8" (9.5mm)	26.7	%	
	#4 (4.75mm)	5.8	%	0-8
	#8 (2.36mm)	2.5	%	
	#16 (1.18mm)	2.1	%	
	#30 (.6mm)	2.0	%	
	#50 (.3mm)	1.9	%	
	#100 (.15mm)	1.8	%	
	#200 (75µm)	1.6	%	
	Wash Loss (#200/75um)	1.4	%	0-2
	Total Moisture	2.1	%	