

# Aggregate Optimization Chart

# Production Gradation Report

PLANT #: **P-32**

Sample Date: 11/30/20

Dates Test Represents: 12/1/2020

through 12/7/2020


Concrete Grade: **S2M**

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (ssd)	ft <sup>3</sup>	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1670	10.21	2.62	54.8
26A	71-47	Presque Isle	150	0.92	2.62	4.9
2NS	95-013	Smelter Bay	1230	7.44	2.65	40.3
<b>Total Wt</b>			<b>3050</b>	<b>18.57</b>		<b>100.0</b>

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	99.3	100.0	100.0	99.6	0.4	0.4
3/4"	86.2	100.0	100.0	92.4	7.2	7.6
1/2"	43.5	100.0	100.0	69.1	23.4	30.9
3/8"	22.0	79.7	100.0	56.3	12.8	43.7
#4	3.0	19.4	96.7	41.6	14.7	58.4
#8	2.2	8.8	82.0	34.7	6.9	65.3
#16	2.1	5.1	65.7	27.9	6.8	72.1
#30	2.0	3.9	44.6	19.3	8.6	80.7
#50	2.0	3.1	21.0	9.7	9.6	90.3
#100	1.9	2.5	5.7	3.5	6.3	96.5
LBW	1.7	1.8	1.5	1.6	1.8	98.4



Superior Materials, LLC  
30701 W. 10 Mile Rd.  
Suite 500  
Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	99.3	100.0	100.0	99.6	0.4	0.4
3/4"	86.2	100.0	100.0	92.4	7.2	7.6
1/2"	43.5	100.0	100.0	69.1	23.4	30.9
3/8"	22.0	79.7	100.0	56.3	12.8	43.7
#4	3.0	19.4	96.7	41.6	14.7	58.4
#8	2.2	8.8	82.0	34.7	6.9	65.3
#16	2.1	5.1	65.7	27.9	6.8	72.1
#30	2.0	3.9	44.6	19.3	8.6	80.7
#50	2.0	3.1	21.0	9.7	9.6	90.3
#100	1.9	2.5	5.7	3.5	6.3	96.5
LBW	1.7	1.8	1.5	1.6	1.8	98.4


\*Maximum % Retained must be above the 3/8" sieve.  
\*Any two adjacent sieves must equal 10% except max., nom. max. #100 and #200 sieves.  
\*% Retained must be at least 4% for each sieve except max., nom. max. #100 and #200 sieves.  
\*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

Initial Production Sample (IPS)

Coarseness Factor: **67** Workability Factor: **35**

Coarseness Factor: **62** Workability Factor: **35**

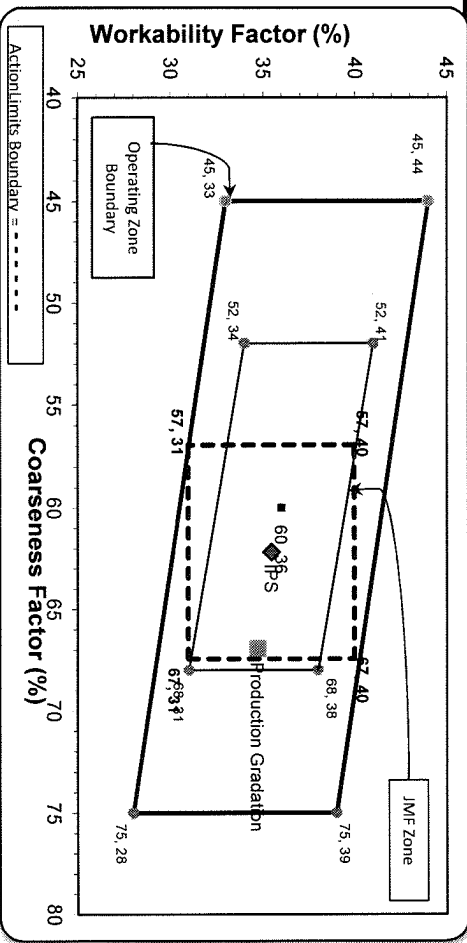

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	94.0	6.0	6.0
1/2"	70.2	23.7	29.8
3/8"	59.9	10.4	40.1
#4	42.7	17.2	57.3
#8	35.5	7.2	64.5
#16	28.4	7.0	71.6
#30	19.2	9.2	80.8
#50	8.9	10.3	91.1
#100	3.1	5.9	96.9
LBW	1.4	1.7	98.6

PREPARED BY:  
SM, LLC Technical Service

Approved By: \_\_\_\_\_

Edw. C. Levy Co.

Plant 958-JMT

Product 1054-6AA LS PI

Name/Title Doug Storey / QC Technician

Period: 11/29/2020 - 12/05/2020

Report Date 12/04/2020

Procedure	Sieve/Test	Result	Unit	6AA LS PI Spec
	2" (50mm)	100.0	%	
	1 1/2" (37.5mm)	100.0	%	100-100
	1" (25mm)	99.3	%	95-100
	3/4" (19mm)	86.2	%	
	1/2" (12.5mm)	43.5	%	30-60
	3/8" (9.5mm)	22.0	%	
	#4 (4.75mm)	3.0	%	0-8
	#8 (2.36mm)	2.2	%	
	#16 (1.18mm)	2.1	%	
	#30 (.6mm)	2.0	%	
	#50 (.3mm)	2.0	%	
	#100 (.15mm)	1.9	%	
	#200 (75µm)	1.7	%	
	Wash Loss (#200/75um)	1.5	%	0-2
	Total Moisture	3.2	%	

# Edw. C. Levy Co.

Plant 958-JMT

Product 1067-26A Mod LS

Name/Title Doug Storey / QC Technician

Period: 11/29/2020 - 12/05/2020

Report Date 12/04/2020

Procedure	Sieve/Test	Result	Unit	26A Mod LS Spec
	2" (50mm)	100.0	%	
	1 1/2" (37.5mm)	100.0	%	
	1" (25mm)	100.0	%	
	3/4" (19mm)	100.0	%	100-100
	1/2" (12.5mm)	100.0	%	95-100
	3/8" (9.5mm)	79.7	%	60-95
	#4 (4.75mm)	19.4	%	5-30
	#8 (2.36mm)	8.8	%	0-12
	#16 (1.18mm)	5.1	%	
	#30 (.6mm)	3.9	%	
	#50 (.3mm)	3.1	%	
	#100 (.15mm)	2.5	%	
	#200 (75µm)	2.0	%	
	Wash Loss (#200/75um)	1.8	%	0-3
	Total Moisture	5.0	%	

**Edw. C. Levy Co.**

**Plant** 958-JMT  
**Product** 1022-2NS GR - Smelter Bay  
**Period:** 11/29/2020 - 12/05/2020

**Name/Title** Doug Storey / QC Technician  
**Report Date** 12/04/2020

Procedure	Sieve/Test	Result	Unit	2NS GR Spec
	3/8" (9.5mm)	100.0	%	100-100
	#4 (4.75mm)	96.7	%	95-100
	#8 (2.36mm)	82.0	%	65-95
	#16 (1.18mm)	65.7	%	35-75
	#30 (.6mm)	44.6	%	20-55
	#50 (.3mm)	21.0	%	10-30
	#100 (.15mm)	5.7	%	0-10
	#200 (75µm)	2.0	%	
	FM	2.84		2.6-3
	Wash Loss (#200/75um)	1.5	%	0-3
	Total Moisture	5.1	%	