

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-32**

Sample Date: **10/18/21**


Dates Test Represents: **10/19/2021** through **10/25/2021**

Concrete Grade: **DM**

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (ssd)	ft ³	Specific Gravity	Contribution %
6AA	71-47	Presque Isle	1455	8.90	2.62	50.1
26A	71-47	Presque Isle	300	1.83	2.62	10.3
2NS	95-013	Smelter Bay	1150	6.95	2.65	39.6
Total Wt						17.69
						100.0




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	98.5	100.0	100.0	99.2	0.8	0.8
3/4"	79.2	100.0	100.0	89.6	9.7	10.4
1/2"	36.1	97.1	100.0	67.7	21.9	32.3
3/8"	21.9	84.5	100.0	59.3	8.4	40.7
#4	4.5	14.9	96.3	41.9	17.4	58.1
#8	2.5	3.6	84.0	34.9	7.0	65.1
#16	2.2	2.1	67.7	28.1	6.8	71.9
#30	2.1	1.8	47.1	19.9	8.2	80.1
#50	2.0	1.7	21.5	9.7	10.2	90.3
#100	1.8	1.5	6.6	3.7	6.0	96.3
LBW	1.3	1.4	1.4	1.3	2.3	98.7

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max. nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max. nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation	<input checked="" type="radio"/> Batch Plant Gradations	<input type="radio"/> Aggregate Supplier Gradations
Coarseness Factor:	63	Workability Factor: 35
		Adjusted WF: 37.4

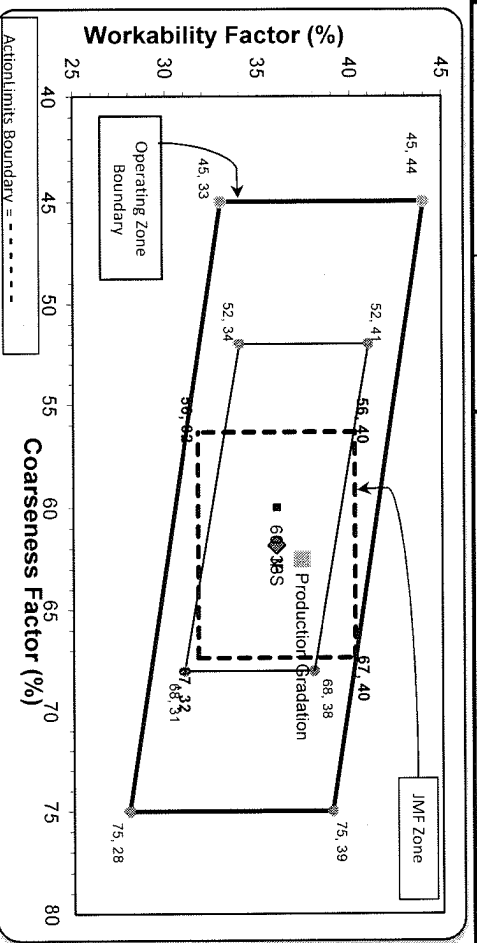

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	95.0	5.0	5.0
1/2"	72.3	22.8	27.7
3/8"	60.4	11.8	39.6
#4	42.6	17.8	57.4
#8	36.0	6.6	64.0
#16	29.5	6.5	70.5
#30	20.3	9.2	79.7
#50	9.5	10.8	90.5
#100	3.4	6.1	96.6
LBW	1.3	2.1	98.7

PREPARED BY:
 SM, LLC Technical Service

Approved By: _____

Plant 958-JMT
 Product 1022-2NS GR - Smelter Bay
 Period: 10/17/2021 - 10/23/2021

Name/Title Doug Storey / QC Technician
 Report Date 10/22/2021

Procedure	Sieve/Test	Result	Unit	2NS GR Spec
	3/8" (9.5mm)	100.0	%	100-100
	#4 (4.75mm)	96.3	%	95-100
	#8 (2.36mm)	84.0	%	65-95
	#16 (1.18mm)	67.7	%	35-75
	#30 (.6mm)	47.1	%	20-55
	#50 (.3mm)	21.5	%	10-30
	#100 (.15mm)	6.6	%	0-10
	#200 (75µm)	1.7	%	
	FM	2.77		2.6-3
	Wash Loss (#200/75um)	1.4	%	0-3
	Total Moisture	4.4	%	

Plant 958-JMT

Product 1067-26A Mod LS

Name/Title Doug Storey / QC Technician

Period: 10/17/2021 - 10/23/2021

Report Date 10/22/2021

Procedure	Sieve/Test	Result	Unit	26A Mod LS Spec
	2" (50mm)	100.0	%	
	1 1/2" (37.5mm)	100.0	%	
	1" (25mm)	100.0	%	
	3/4" (19mm)	100.0	%	100-100
	1/2" (12.5mm)	97.1	%	95-100
	3/8" (9.5mm)	84.5	%	60-95
	#4 (4.75mm)	14.9	%	5-30
	#8 (2.36mm)	3.6	%	0-12
	#16 (1.18mm)	2.1	%	
	#30 (.6mm)	1.8	%	
	#50 (.3mm)	1.7	%	
	#100 (.15mm)	1.5	%	
	#200 (75µm)	1.4	%	
	Wash Loss (#200/75um)	1.4	%	0-3
	Total Moisture	3.8	%	

Plant 958-JMT
 Product 1054-6AA LS PI
 Period: 10/17/2021 - 10/23/2021

Name/Title Doug Storey / QC Technician
 Report Date 10/22/2021

Procedure	Sieve/Test	Result	Unit	6AA LS PI Spec
	2" (50mm)	100.0	%	
	1 1/2" (37.5mm)	100.0	%	100-100
	1" (25mm)	98.5	%	95-100
	3/4" (19mm)	79.2	%	
	1/2" (12.5mm)	36.1	%	30-60
	3/8" (9.5mm)	21.9	%	
	#4 (4.75mm)	4.5	%	0-8
	#8 (2.36mm)	2.5	%	
	#16 (1.18mm)	2.2	%	
	#30 (.6mm)	2.1	%	
	#50 (.3mm)	2.0	%	
	#100 (.15mm)	1.8	%	
	#200 (75µm)	1.5	%	
	Wash Loss (#200/75um)	1.3	%	0-2
	Total Moisture	2.9	%	