

# Aggregate Optimization Chart

**PLANT #:** **P-101**

Sample Date: 1/17/22

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 1/18/2022 through 1/24/2022

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1070	6.54	2.62	34.9
IA	71-47	Presque Isle	800	4.89	2.62	26.1
2NS	75-051	Mid-Michigan	1200	7.23	2.66	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.67</b>		<b>100.0</b>

<---- Verify this number is 100%



**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.8	100.0	100.0	99.2	0.8	0.8
1"	50.4	100.0	100.0	82.7	16.5	17.3
3/4"	13.2	98.3	100.0	69.3	13.4	30.7
1/2"	4.8	79.6	100.0	61.5	7.8	38.5
3/8"	3.6	58.4	100.0	55.6	5.9	44.4
#4	2.4	12.9	98.5	42.7	12.9	57.3
#8	2.0	3.1	83.3	34.1	8.6	65.9
#16	1.8	1.9	68.3	27.8	6.2	72.2
#30	1.8	1.6	53.3	21.9	5.9	78.1
#50	1.7	1.5	29.2	12.4	9.5	87.6
#100	1.6	1.4	7.3	3.8	8.6	96.2
LBW	1.4	1.2	0.6	1.0	2.7	99.0

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.


Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>67</b>	<b>Workability Factor:</b>	<b>34</b>
---------------------------	-----------	----------------------------	-----------

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>66</b>
<b>Workability Factor:</b>	<b>35</b>

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	84.3	15.3	15.7
3/4"	74.8	9.6	25.2
1/2"	64.3	10.4	35.7
3/8"	56.8	7.5	43.2
#4	43.0	13.8	57.0
#8	34.9	8.1	65.1
#16	26.4	8.5	73.6
#30	19.9	6.5	80.1
#50	10.4	9.5	89.6
#100	3.4	7.0	96.6
LBW	1.2	2.2	98.8

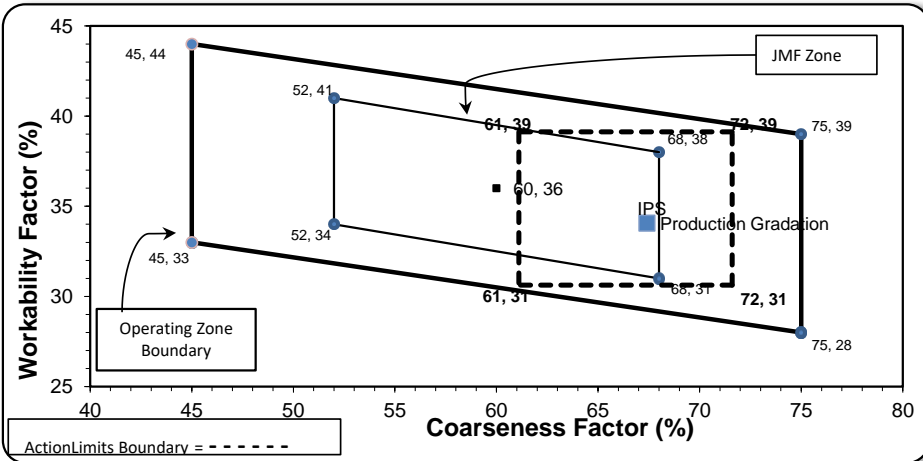

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-102**

Sample Date: 1/17/22

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 1/18/2022 through 1/24/2022

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	58-003	Stoneco	1350	8.04	2.69	43.3
IA	58-003	Stoneco	620	3.69	2.69	19.9
2NS	63-114	Highland	1150	6.95	2.65	36.9
<b>Total Wt</b>			<b>3120</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	65.6	100.0	100.0	85.1	14.9	14.9
3/4"	35.4	100.0	100.0	72.0	13.1	28.0
1/2"	12.1	95.0	100.0	61.0	11.1	39.0
3/8"	7.9	84.2	100.0	57.0	4.0	43.0
#4	2.9	24.9	99.4	42.8	14.2	57.2
#8	2.1	7.9	87.6	34.8	8.1	65.2
#16	1.7	3.8	69.9	27.3	7.5	72.7
#30	1.6	2.8	47.5	18.8	8.5	81.2
#50	1.5	2.6	18.9	8.1	10.6	91.9
#100	1.3	2.5	2.8	2.1	6.0	97.9
LBW	1.2	2.2	0.4	1.1	1.0	98.9

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>66</b>	<b>Workability Factor:</b>	<b>35</b>
---------------------------	-----------	----------------------------	-----------

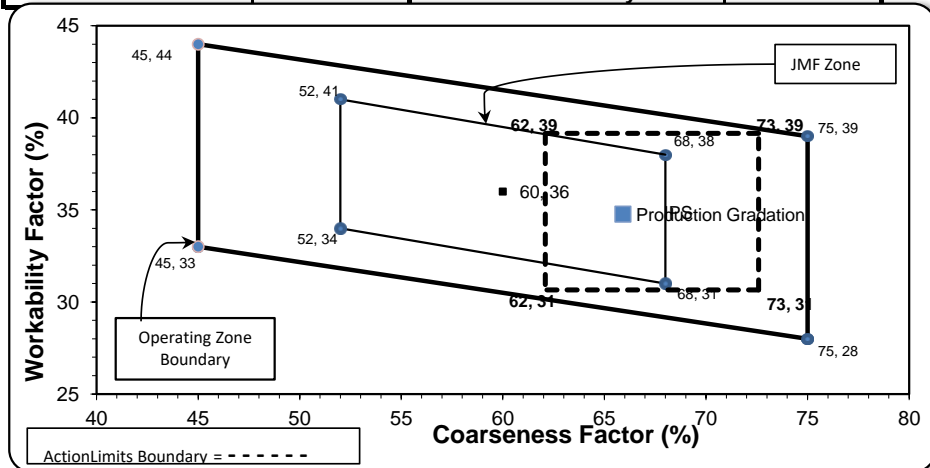

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>67</b>		
<b>Workability Factor:</b>	<b>35</b>		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-12**

Sample Date: 1/17/22

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 1/18/2022 through 1/24/2022

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1020	6.24	2.62	33.2
IA	71-47	Presque Isle	800	4.89	2.62	26.1
2NS	63-115	Ray Rd	1250	7.56	2.65	40.7
<b>Total Wt</b>			<b>3070</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	40.9	100.0	100.0	80.4	19.6	19.6
3/4"	6.5	98.4	100.0	68.5	11.8	31.5
1/2"	1.9	71.1	100.0	59.9	8.6	40.1
3/8"	1.4	47.8	100.0	53.6	6.2	46.4
#4	1.3	11.3	97.3	43.0	10.6	57.0
#8	1.2	4.8	79.9	34.2	8.8	65.8
#16	1.2	3.4	63.9	27.3	6.9	72.7
#30	1.1	3.0	46.8	20.2	7.1	79.8
#50	1.1	2.8	25.6	11.5	8.7	88.5
#100	1.1	2.5	5.1	3.1	8.4	96.9
LBW	0.8	2.1	0.9	1.2	1.9	98.8

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

**Coarseness Factor:** **70**      **Workability Factor:** **34**

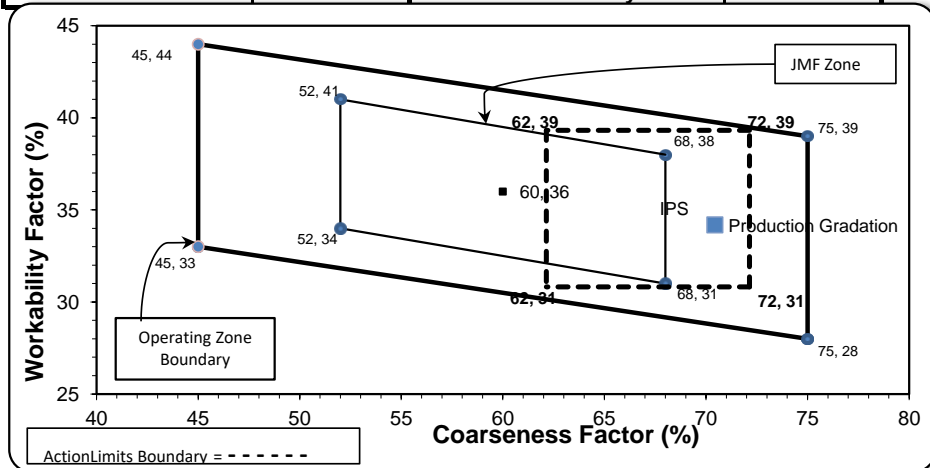

Initial Production Sample (IPS)

**Coarseness Factor:** **67**  
**Workability Factor:** **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.0	9.8	26.0
1/2"	63.7	10.3	36.3
3/8"	56.4	7.3	43.6
#4	43.0	13.4	57.0
#8	35.1	7.9	64.9
#16	29.0	6.1	71.0
#30	20.9	8.0	79.1
#50	8.1	12.8	91.9
#100	1.6	6.5	98.4
LBW	0.9	0.8	99.1

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-32**

Sample Date: 1/17/22

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 1/18/2022 through 1/24/2022

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	870	5.32	2.62	28.3
IA	71-47	Presque Isle	950	5.81	2.62	30.9
2NS	95-013	Smelter Bay	1250	7.56	2.65	40.7
<b>Total Wt</b>			<b>3070</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	40.9	100.0	100.0	83.3	16.7	16.7
3/4"	6.5	98.4	100.0	73.0	10.2	27.0
1/2"	1.9	71.1	100.0	63.3	9.8	36.7
3/8"	1.4	47.8	100.0	55.9	7.4	44.1
#4	1.3	11.3	96.8	43.3	12.6	56.7
#8	1.2	4.8	84.5	36.2	7.0	63.8
#16	1.2	3.4	68.5	29.3	6.9	70.7
#30	1.1	3.0	49.1	21.2	8.1	78.8
#50	1.1	2.8	22.8	10.5	10.8	89.5
#100	1.1	2.5	6.6	3.8	6.7	96.2
LBW	0.8	2.1	1.7	1.6	2.2	98.4

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

**Coarseness Factor:** **69**      **Workability Factor:** **36**

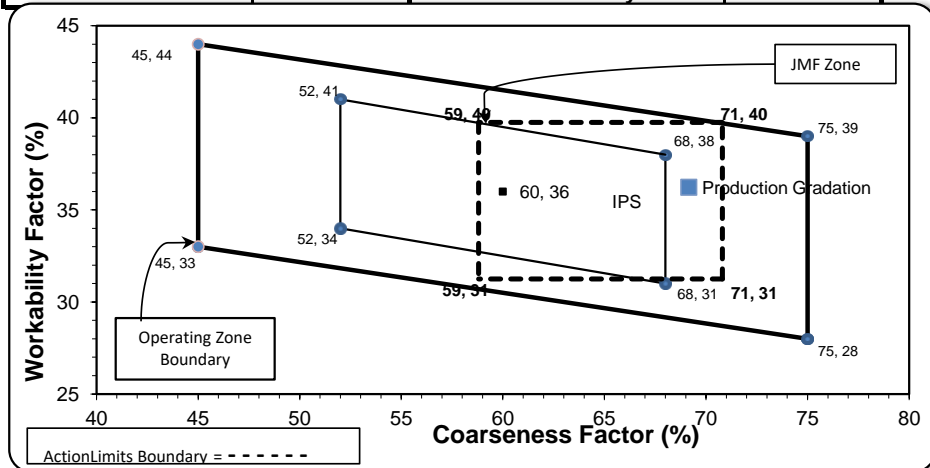

Initial Production Sample (IPS)

**Coarseness Factor:** **65**  
**Workability Factor:** **36**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.0	0.6	0.6
1"	84.0	15.3	16.0
3/4"	73.5	10.5	26.5
1/2"	65.2	8.2	34.8
3/8"	58.2	7.1	41.8
#4	44.1	14.1	55.9
#8	35.5	8.6	64.5
#16	29.1	6.4	70.9
#30	21.9	7.3	78.1
#50	9.6	12.2	90.4
#100	2.6	7.1	97.4
LBW	1.0	1.6	99.0

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-35**

Sample Date: 1/17/22

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 1/18/2022 through 1/24/2022

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	58-003	Stoneco	1380	8.22	2.69	44.2
IA	58-003	Stoneco	620	3.69	2.69	19.9
2NS	81-093	Burmeister	1120	6.77	2.65	35.9
<b>Total Wt</b>			<b>3120</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	65.6	100.0	100.0	84.8	15.2	15.2
3/4"	35.4	100.0	100.0	71.4	13.4	28.6
1/2"	12.1	95.0	100.0	60.1	11.3	39.9
3/8"	7.9	84.2	100.0	56.1	4.0	43.9
#4	2.9	24.9	97.7	41.3	14.8	58.7
#8	2.1	7.9	86.0	33.4	7.9	66.6
#16	1.7	3.8	70.7	26.9	6.5	73.1
#30	1.6	2.8	52.4	20.1	6.8	79.9
#50	1.5	2.6	22.0	9.1	11.0	90.9
#100	1.3	2.5	4.5	2.7	6.4	97.3
LBW	1.2	2.2	1.7	1.6	1.1	98.4

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

**Coarseness Factor:** **66**      **Workability Factor:** **33**

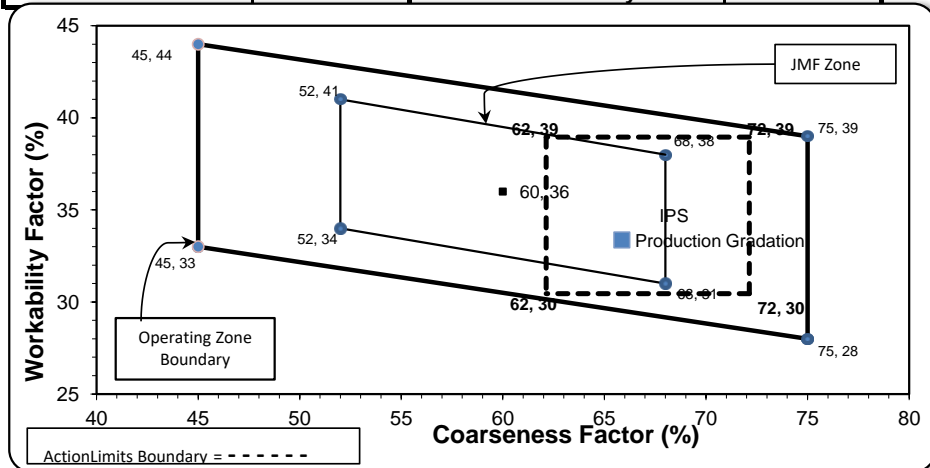

Initial Production Sample (IPS)

**Coarseness Factor:** **67**  
**Workability Factor:** **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	86.9	13.1	13.1
3/4"	76.1	10.8	23.9
1/2"	63.7	12.4	36.3
3/8"	56.2	7.5	43.8
#4	43.2	13.0	56.8
#8	34.7	8.5	65.3
#16	27.5	7.2	72.5
#30	20.6	7.0	79.4
#50	9.0	11.6	91.0
#100	2.1	6.9	97.9
LBW	1.0	1.1	99.0

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-39**

Sample Date: 1/17/22

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 1/18/2022 through 1/24/2022

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1070	6.54	2.62	34.9
IA	71-47	Presque Isle	750	4.59	2.62	24.4
2NS	63-92	Grange Hall	1250	7.56	2.65	40.7
<b>Total Wt</b>			<b>3070</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.8	100.0	100.0	99.2	0.8	0.8
1"	50.4	100.0	100.0	82.7	16.5	17.3
3/4"	13.2	98.3	100.0	69.3	13.4	30.7
1/2"	4.8	79.6	100.0	61.8	7.5	38.2
3/8"	3.6	58.4	100.0	56.2	5.6	43.8
#4	2.4	12.9	97.5	43.7	12.6	56.3
#8	2.0	3.1	82.1	34.9	8.8	65.1
#16	1.8	1.9	66.8	28.3	6.6	71.7
#30	1.8	1.6	49.8	21.3	7.0	78.7
#50	1.7	1.5	25.4	11.3	10.0	88.7
#100	1.6	1.4	4.2	2.6	8.7	97.4
LBW	1.4	1.2	0.4	0.9	1.7	99.1

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

**Coarseness Factor:** **67**      **Workability Factor:** **35**

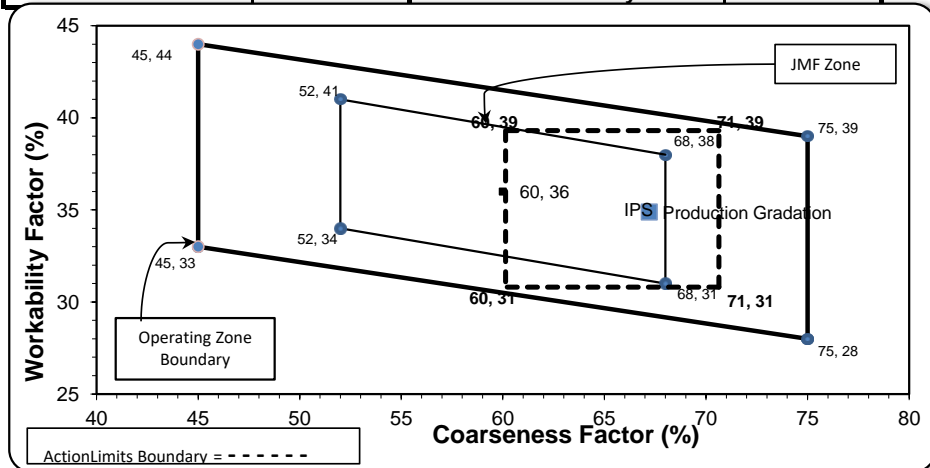

Initial Production Sample (IPS)

**Coarseness Factor:** **65**  
**Workability Factor:** **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.1	9.8	25.9
1/2"	64.3	9.7	35.7
3/8"	57.5	6.8	42.5
#4	44.5	13.1	55.5
#8	35.1	9.4	64.9
#16	27.9	7.2	72.1
#30	21.7	6.2	78.3
#50	12.6	9.1	87.4
#100	3.5	9.1	96.5
LBW	1.2	2.4	98.8

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** P-02

Sample Date: 1/17/22

Concrete Grade: P1M

Contractor: \_\_\_\_\_

Dates Test Represents: 1/18/2022 through 1/24/2022

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	970	5.93	2.62	31.6
IA	71-47	Presque Isle	850	5.20	2.62	27.7
2NS	63-115	Ray Rd	1250	7.56	2.65	40.7
<b>Total Wt</b>			<b>3070</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	40.9	100.0	100.0	81.3	18.7	18.7
3/4"	6.5	98.4	100.0	70.0	11.3	30.0
1/2"	1.9	71.1	100.0	61.0	9.0	39.0
3/8"	1.4	47.8	100.0	54.4	6.6	45.6
#4	1.3	11.3	97.3	43.2	11.2	56.8
#8	1.2	4.8	79.9	34.2	8.9	65.8
#16	1.2	3.4	63.9	27.3	6.9	72.7
#30	1.1	3.0	46.8	20.2	7.1	79.8
#50	1.1	2.8	25.6	11.5	8.7	88.5
#100	1.1	2.5	5.1	3.1	8.4	96.9
LBW	0.8	2.1	0.9	1.2	1.9	98.8

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

**Coarseness Factor:** 69      **Workability Factor:** 34

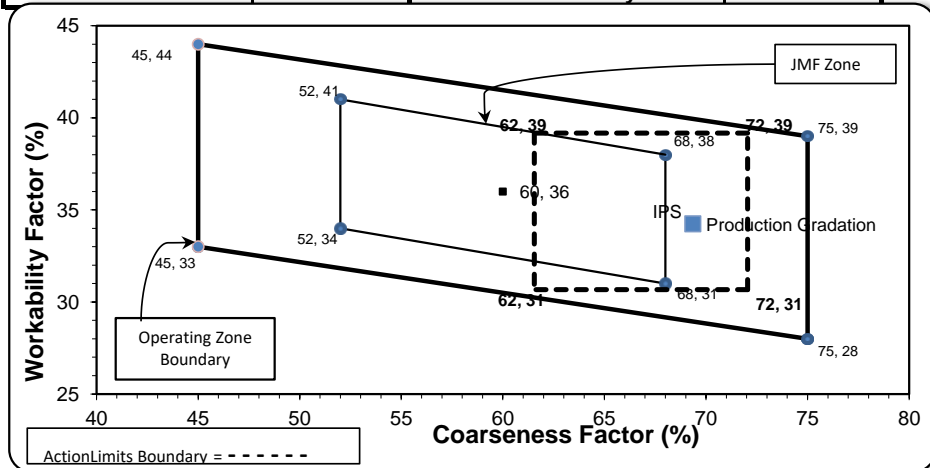

Initial Production Sample (IPS)

**Coarseness Factor:** 67  
**Workability Factor:** 35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.3	12.7	27.7
1/2"	64.5	7.8	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:  
 SM, LLC Technical Service

Approved By: