

Aggregate Optimization Chart

Production Gradation Report

PLANT #: P-32

Sample Date: 8/1/22


Dates Test Represents: 8/2/2022

through 8/8/2022

Concrete Grade: S2M, 3500HP

Contractor: _____

MDOT No.: _____



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336


Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	Contribution %
6AA	71-47	Presque Isle	1620	9.91	2.62	53.1
26A	71-47	Presque Isle	200	1.22	2.62	6.6
2NS	95-013	Smelter Bay	1230	7.44	2.65	40.3
		Total Wt	3050	18.57		100.0

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	80.2	100.0	100.0	89.5	10.5	10.5
1/2"	43.6	100.0	100.0	69.8	19.7	30.2
3/8"	24.9	85.6	100.0	59.2	10.6	40.8
#4	4.4	28.1	96.8	43.2	15.9	56.8
#8	2.0	8.7	84.7	35.8	7.4	64.2
#16	1.8	4.0	69.2	29.1	6.7	70.9
#30	1.7	3.0	49.9	21.2	7.9	78.8
#50	1.6	2.7	24.5	10.9	10.3	89.1
#100	1.6	2.5	7.4	4.0	6.9	96.0
LBW	1.3	2.1	1.6	1.5	2.5	98.5

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 ** Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *** Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: 64 **Workability Factor:** 36

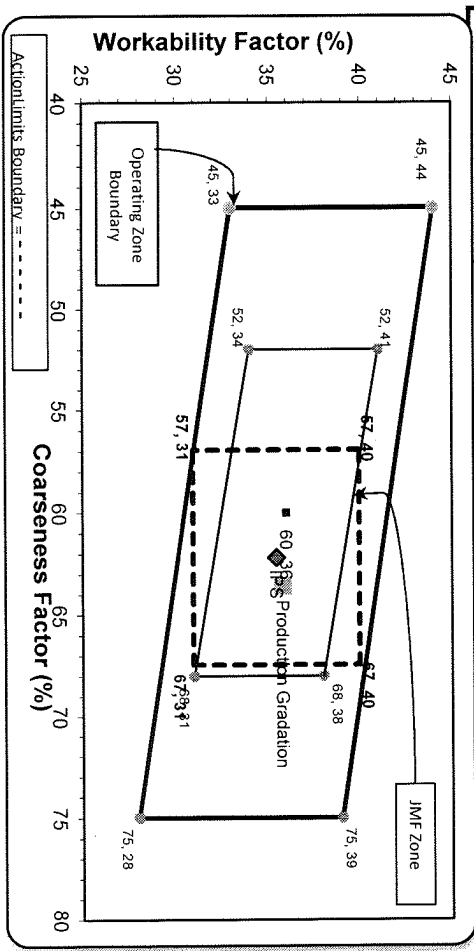

Initial Production Sample (IPS)

Coarseness Factor:	62		
Workability Factor:	35		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	94.0	6.0	6.0
1/2"	70.2	23.7	29.8
3/8"	59.9	10.4	40.1
#4	42.7	17.2	57.3
#8	35.5	7.2	64.5
#16	28.4	7.0	71.6
#30	19.2	9.2	80.8
#50	8.9	10.3	91.1
#100	3.1	5.9	96.9
LBW	1.4	1.7	98.6

PREPARED BY:
 SM, LLC Technical Service

Approved By: _____

Plant 958-JMT

Product 1022-2NS GR - Smelter Bay

Name/Title Doug Storey / QC Technician

Period: 07/31/2022 - 08/06/2022

Report Date 08/05/2022

Procedure	Sieve/Test	Result	Unit	2NS GR Spec
	3/8" (9.5mm)	100.0	%	100-100
	#4 (4.75mm)	96.8	%	95-100
	#8 (2.36mm)	84.7	%	65-95
	#16 (1.18mm)	69.2	%	35-75
	#30 (.6mm)	49.9	%	20-55
	#50 (.3mm)	24.5	%	10-30
	#100 (.15mm)	7.4	%	0-10
	#200 (75µm)	2.0	%	
	FM	2.67		2.6-3
	Wash Loss (#200/75um)	1.6	%	0-3
	Total Moisture	3.4	%	

Plant 958-JMT
 Product 1067-26A Mod LS
 Period: 07/31/2022 - 08/06/2022

Name/Title Doug Storey / QC Technician
 Report Date 08/05/2022

Procedure	Sieve/Test	Result	Unit	26A Mod LS Spec
	2" (50mm)	100.0	%	
	1 1/2" (37.5mm)	100.0	%	
	1" (25mm)	100.0	%	
	3/4" (19mm)	100.0	%	100-100
	1/2" (12.5mm)	96.3	%	95-100
	3/8" (9.5mm)	85.6	%	60-95
	#4 (4.75mm)	28.1	%	5-30
	#8 (2.36mm)	8.7	%	0-12
	#16 (1.18mm)	4.0	%	
	#30 (.6mm)	3.0	%	
	#50 (.3mm)	2.7	%	
	#100 (.15mm)	2.5	%	
	#200 (75µm)	2.2	%	
	Wash Loss (#200/75um)	2.1	%	0-3
	Total Moisture	3.4	%	

Plant 958-JMT

Product 1054-6AA LS PI

Name/Title Doug Storey / QC Technician

Period: 07/31/2022 - 08/06/2022

Report Date 08/05/2022

Procedure	Sieve/Test	Result	Unit	6AA LS PI Spec
	2" (50mm)	100.0	%	
	1 1/2" (37.5mm)	100.0	%	100-100
	1" (25mm)	100.0	%	95-100
	3/4" (19mm)	80.2	%	
	1/2" (12.5mm)	43.6	%	30-60
	3/8" (9.5mm)	24.9	%	
	#4 (4.75mm)	4.4	%	0-8
	#8 (2.36mm)	2.0	%	
	#16 (1.18mm)	1.8	%	
	#30 (.6mm)	1.7	%	
	#50 (.3mm)	1.6	%	
	#100 (.15mm)	1.6	%	
	#200 (75µm)	1.4	%	
	Wash Loss (#200/75um)	1.3	%	0-2
	Total Moisture	1.0	%	