

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-102**

Sample Date: 8/12/24

Concrete Grade: DM, 4500HP

Contractor: _____

Dates Test Represents: 8/13/2024 through 8/19/2024

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1475	8.79	2.69	50.0
26A	58-003	Stoneco	325	1.94	2.69	11.0
2NS	63-114	Highland	1150	6.95	2.65	39.0
Total Wt			2950	17.68		100.0

<----- Verify this number is 100%



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	87.6	100.0	100.0	93.8	6.2	6.2
1/2"	47.2	98.9	100.0	73.5	20.3	26.5
3/8"	26.9	80.6	100.0	61.3	12.2	38.7
#4	3.9	8.4	98.9	41.4	19.9	58.6
#8	1.6	1.4	85.1	34.1	7.3	65.9
#16	1.2	1.2	67.4	27.0	7.1	73.0
#30	1.1	1.0	48.5	19.6	7.4	80.4
#50	1.1	1.0	20.5	8.7	10.9	91.3
#100	1.0	1.0	3.6	2.0	6.6	98.0
LBW	1.0	0.8	0.7	0.9	1.2	99.1

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for the 3/4" sieve when

a 1.5" max. size (nom. Max. 1.0") aggregate is used.


Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	59	Workability Factor:	34	36.6
---------------------------	-----------	----------------------------	-----------	-------------

Coarseness Factor:	61
---------------------------	-----------

Workability Factor:	36
----------------------------	-----------

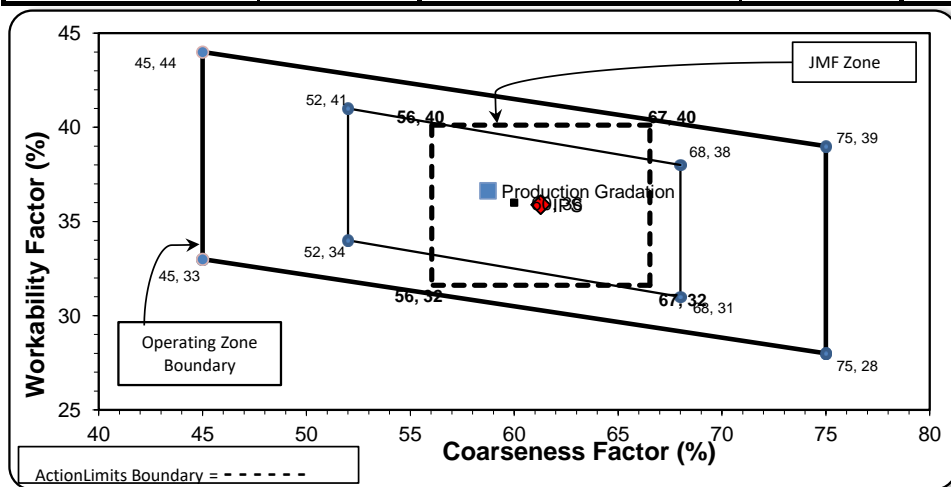

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.2	10.1	10.8
1/2"	70.7	18.5	29.3
3/8"	60.7	10.0	39.3
#4	44.4	16.3	55.6
#8	35.9	8.5	64.1
#16	27.3	8.6	72.7
#30	19.1	8.2	80.9
#50	7.4	11.7	92.6
#100	1.9	5.6	98.1
LBW	0.7	1.2	99.3

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-103**

Sample Date: 8/12/24

Concrete Grade: DM, 4500HP

Contractor: _____

Dates Test Represents: 8/13/2024 through 8/19/2024

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1475	8.79	2.69	50.0
26A	58-003	Stoneco	325	1.94	2.69	11.0
2NS	63-114	Highland	1150	6.95	2.65	39.0
Total Wt			2950	17.68		100.0

<----- Verify this number is 100%



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	87.6	100.0	100.0	93.8	6.2	6.2
1/2"	47.2	98.9	100.0	73.5	20.3	26.5
3/8"	26.9	80.6	100.0	61.3	12.2	38.7
#4	3.9	8.4	98.9	41.4	19.9	58.6
#8	1.6	1.4	85.1	34.1	7.3	65.9
#16	1.2	1.2	67.4	27.0	7.1	73.0
#30	1.1	1.0	48.5	19.6	7.4	80.4
#50	1.1	1.0	20.5	8.7	10.9	91.3
#100	1.0	1.0	3.6	2.0	6.6	98.0
LBW	1.0	0.8	0.7	0.9	1.2	99.1

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for the 3/4" sieve when

a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations


Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	59	Workability Factor:	34	36.6
---------------------------	-----------	----------------------------	-----------	-------------

Coarseness Factor:	61
---------------------------	-----------

Workability Factor:	36
----------------------------	-----------

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.2	10.1	10.8
1/2"	70.7	18.5	29.3
3/8"	60.7	10.0	39.3
#4	44.4	16.3	55.6
#8	35.9	8.5	64.1
#16	27.3	8.6	72.7
#30	19.1	8.2	80.9
#50	7.4	11.7	92.6
#100	1.9	5.6	98.1
LBW	0.7	1.2	99.3

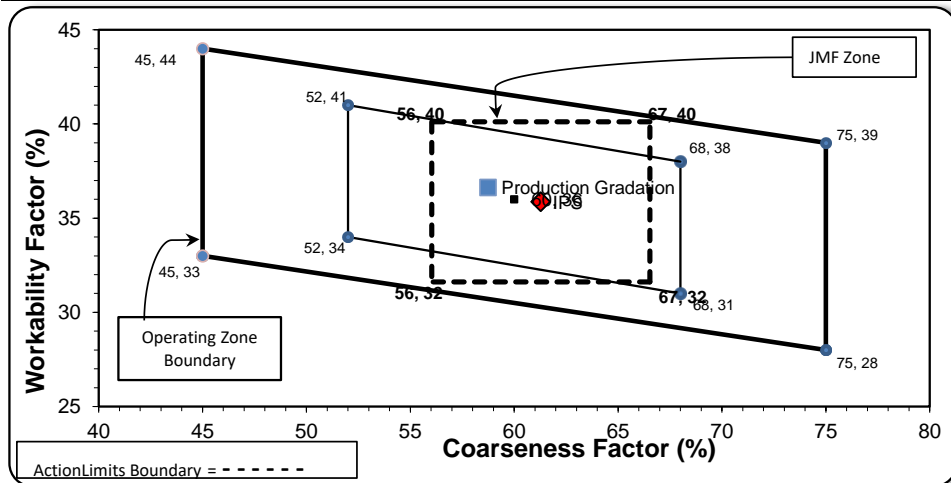

PREPARED BY:
 SM, LLC Technical Service

Approved BY:

Aggregate Optimization Chart

PLANT #: 12

Sample Date: 8/12/24

Concrete Grade: DM, 4500HP

Contractor: _____

Dates Test Represents: 8/13/2024 through 8/19/2024

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1450	8.87	2.62	49.9
26A	71-47	Presque Isle	305	1.87	2.62	10.5
2NS	63-115	Ray Rd	1150	6.95	2.65	39.6
Total Wt			2905	17.69		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	96.0	100.0	100.0	98.0	2.0	2.0
3/4"	72.2	100.0	100.0	86.1	11.9	13.9
1/2"	32.0	95.4	100.0	65.6	20.5	34.4
3/8"	16.9	85.3	100.0	57.0	8.6	43.0
#4	3.5	19.1	97.0	42.2	14.8	57.8
#8	2.4	4.0	77.6	32.3	9.8	67.7
#16	2.1	2.2	61.0	25.4	6.9	74.6
#30	2.0	1.8	46.3	19.5	5.9	80.5
#50	1.9	1.7	26.1	11.5	8.1	88.5
#100	1.8	1.6	7.6	4.1	7.4	95.9
LBW	1.4	1.4	0.9	1.2	2.9	98.8

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for the 3/4" sieve when a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	64	Workability Factor:	32	Adjusted WF	34.8	Coarseness Factor:	63
---------------------------	-----------	----------------------------	-----------	--------------------	-------------	---------------------------	-----------

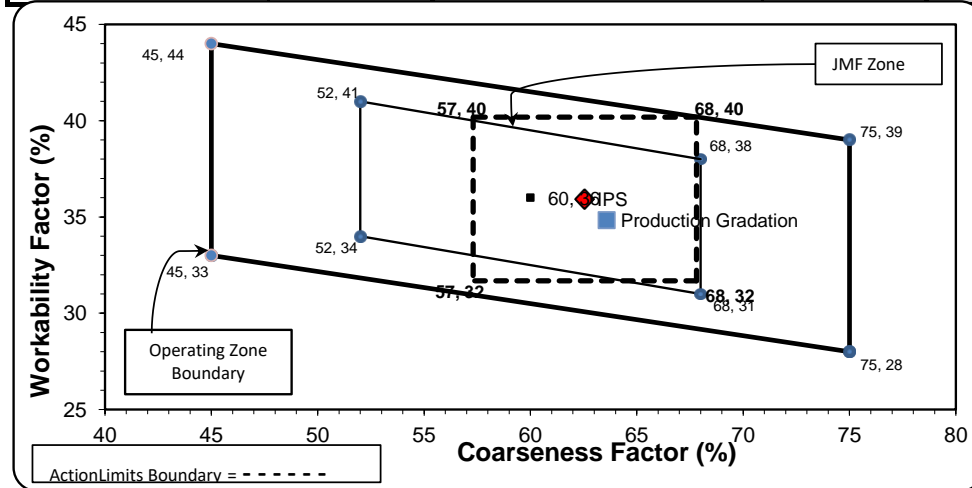

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.0	10.3	11.0
1/2"	70.3	18.7	29.7
3/8"	59.9	10.4	40.1
#4	41.9	18.0	58.1
#8	35.9	6.0	64.1
#16	27.8	8.2	72.2
#30	18.9	8.8	81.1
#50	6.3	12.6	93.7
#100	1.7	4.6	98.3
LBW	1.0	0.7	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: p11

Contractor: _____

Sample Date: 8/12/24

Concrete Grade: DM, 4500HP

Dates Test Represents: 8/13/2024 through 8/19/2024

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1455	8.90	2.62	50.1
26A	71-47	Presque Isle	300	1.83	2.62	10.3
2NS	63-115	Ray Rd	1150	6.95	2.65	39.6
Total Wt			2905	17.69		100.0

<----- Verify this number is 100%



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336


Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	96.0	100.0	100.0	98.0	2.0	2.0
3/4"	72.2	100.0	100.0	86.1	11.9	13.9
1/2"	32.0	95.4	100.0	65.5	20.6	34.5
3/8"	16.9	85.3	100.0	56.9	8.6	43.1
#4	3.5	19.1	97.0	42.1	14.7	57.9
#8	2.4	4.0	77.6	32.3	9.8	67.7
#16	2.1	2.2	61.0	25.4	6.9	74.6
#30	2.0	1.8	46.3	19.5	5.9	80.5
#50	1.9	1.7	26.1	11.5	8.1	88.5
#100	1.8	1.6	7.6	4.1	7.4	95.9
LBW	1.4	1.4	0.9	1.2	2.9	98.8

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for the 3/4" sieve when a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	64	Workability Factor:	32	Adjusted WF	34.8	Coarseness Factor:	62
--------------------	-----------	---------------------	-----------	-------------	-------------	--------------------	-----------

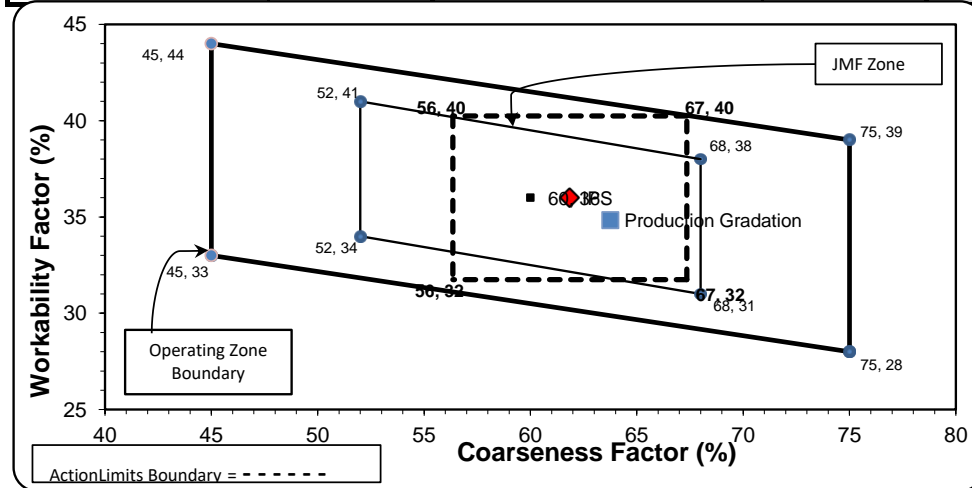

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	95.0	5.0	5.0
1/2"	72.3	22.8	27.7
3/8"	60.4	11.8	39.6
#4	42.6	17.8	57.4
#8	36.0	6.6	64.0
#16	29.5	6.5	70.5
#30	20.3	9.2	79.7
#50	9.5	10.8	90.5
#100	3.4	6.1	96.6
LBW	1.3	2.1	98.7

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-35**

Sample Date: 8/12/24

Concrete Grade: DM, 4500HP

Contractor: _____

Dates Test Represents: 8/13/2024 through 8/19/2024

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1475	8.79	2.69	50.0
26A	58-003	Stoneco	325	1.94	2.69	11.0
2NS	81-019	Pleasant Lake	1150	6.95	2.65	39.0
Total Wt			2950	17.68		100.0

<----- Verify this number is 100%



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	87.6	100.0	100.0	93.8	6.2	6.2
1/2"	47.2	98.9	100.0	73.5	20.3	26.5
3/8"	26.9	80.6	100.0	61.3	12.2	38.7
#4	3.9	8.4	98.4	41.2	20.1	58.8
#8	1.6	1.4	86.4	34.6	6.6	65.4
#16	1.2	1.2	66.2	26.5	8.1	73.5
#30	1.1	1.0	45.1	18.2	8.3	81.8
#50	1.1	1.0	20.2	8.5	9.7	91.5
#100	1.0	1.0	3.7	2.1	6.5	97.9
LBW	1.0	0.8	0.6	0.8	1.2	99.2


*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for the 3/4" sieve when a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	59	Workability Factor:	35	37.1
---------------------------	-----------	----------------------------	-----------	-------------

Coarseness Factor:	61
Workability Factor:	36

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.1	10.2	10.9
1/2"	70.5	18.6	29.5
3/8"	60.5	10.0	39.5
#4	44.1	16.4	55.9
#8	35.6	8.5	64.4
#16	27.7	7.9	72.3
#30	20.6	7.1	79.4
#50	8.7	11.8	91.3
#100	1.6	7.1	98.4
LBW	1.1	0.6	98.9

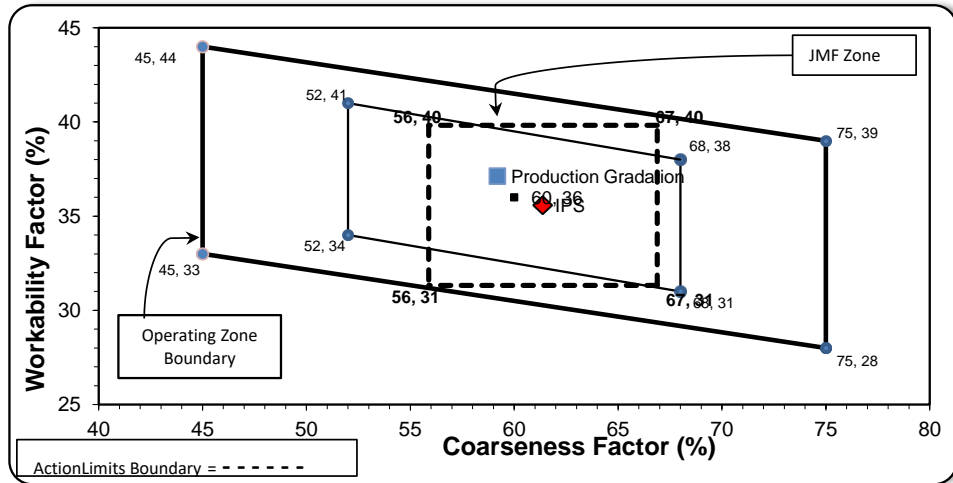

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-38**

Sample Date: 8/12/24

Concrete Grade: DM, 4500HP

Contractor: _____

Dates Test Represents: 8/13/2024 through 8/19/2024

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1475	8.79	2.69	50.0
26A	58-003	Stoneco	325	1.94	2.69	11.0
2NS	81-019	Pleasant Lake	1150	6.95	2.65	39.0
Total Wt			2950	17.68		100.0

<----- Verify this number is 100%



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	87.6	100.0	100.0	93.8	6.2	6.2
1/2"	47.2	98.9	100.0	73.5	20.3	26.5
3/8"	26.9	80.6	100.0	61.3	12.2	38.7
#4	3.9	8.4	98.4	41.2	20.1	58.8
#8	1.6	1.4	86.4	34.6	6.6	65.4
#16	1.2	1.2	66.2	26.5	8.1	73.5
#30	1.1	1.0	45.1	18.2	8.3	81.8
#50	1.1	1.0	20.2	8.5	9.7	91.5
#100	1.0	1.0	3.7	2.1	6.5	97.9
LBW	1.0	0.8	0.6	0.8	1.2	99.2


*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for the 3/4" sieve when a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	59	Workability Factor:	35	37.1
---------------------------	-----------	----------------------------	-----------	-------------

Coarseness Factor:	61
---------------------------	-----------

Workability Factor:	36
----------------------------	-----------

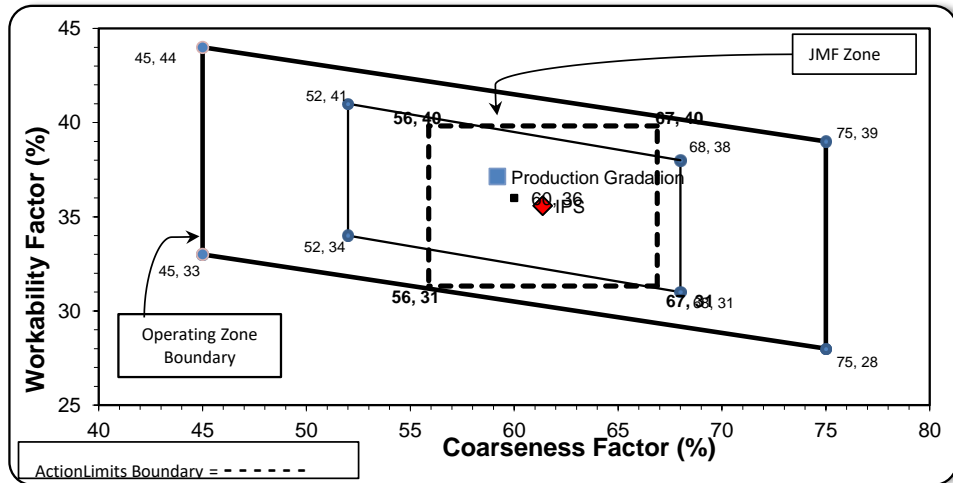

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.1	10.2	10.9
1/2"	70.5	18.6	29.5
3/8"	60.5	10.0	39.5
#4	44.1	16.4	55.9
#8	35.6	8.5	64.4
#16	27.7	7.9	72.3
#30	20.6	7.1	79.4
#50	8.7	11.8	91.3
#100	1.6	7.1	98.4
LBW	1.1	0.6	98.9

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: P-02

Sample Date: 8/12/24

Concrete Grade: **DM, 4500HP**

Contractor: _____

Dates Test Represents: 8/13/2024 through 8/19/2024

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1450	8.87	2.62	49.9
26A	71-47	Presque Isle	305	1.87	2.62	10.5
2NS	63-115	Ray Rd	1150	6.95	2.65	39.6
Total Wt			2905	17.69		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	96.0	100.0	100.0	98.0	2.0	2.0
3/4"	72.2	100.0	100.0	86.1	11.9	13.9
1/2"	32.0	95.4	100.0	65.6	20.5	34.4
3/8"	16.9	85.3	100.0	57.0	8.6	43.0
#4	3.5	19.1	97.0	42.2	14.8	57.8
#8	2.4	4.0	77.6	32.3	9.8	67.7
#16	2.1	2.2	61.0	25.4	6.9	74.6
#30	2.0	1.8	46.3	19.5	5.9	80.5
#50	1.9	1.7	26.1	11.5	8.1	88.5
#100	1.8	1.6	7.6	4.1	7.4	95.9
LBW	1.4	1.4	0.9	1.2	2.9	98.8

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for the 3/4" sieve when a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations Adjusted WF Initial Production Sample (IPS)

Coarseness Factor: 64	Workability Factor: 32	Adjusted WF: 34.8	Coarseness Factor: 63
------------------------------	-------------------------------	--------------------------	------------------------------

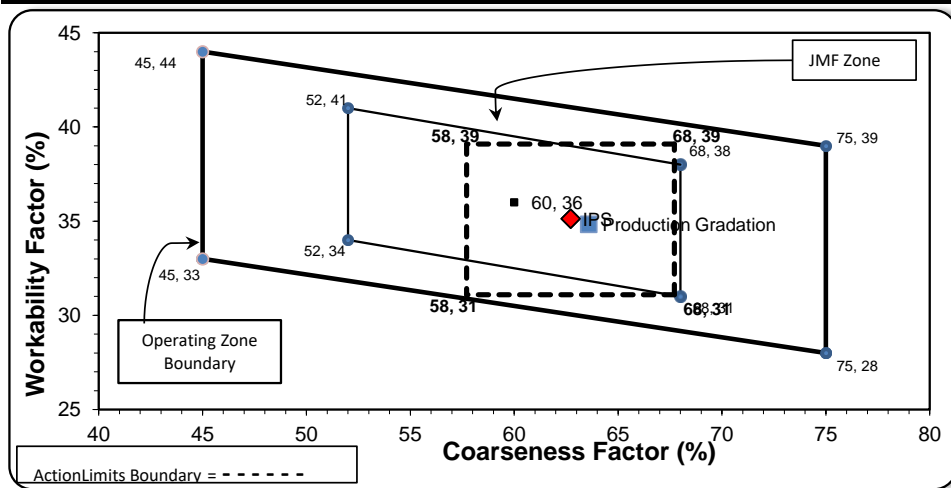

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	95.1	4.9	4.9
1/2"	74.6	20.5	25.4
3/8"	59.3	15.3	40.7
#4	42.1	17.2	57.9
#8	35.1	7.1	64.9
#16	29.2	5.9	70.8
#30	21.9	7.3	78.1
#50	9.6	12.4	90.4
#100	2.4	7.2	97.6
LBW	0.9	1.5	99.1

PREPARED BY:
 SM, LLC Technical Service

Approved By: